
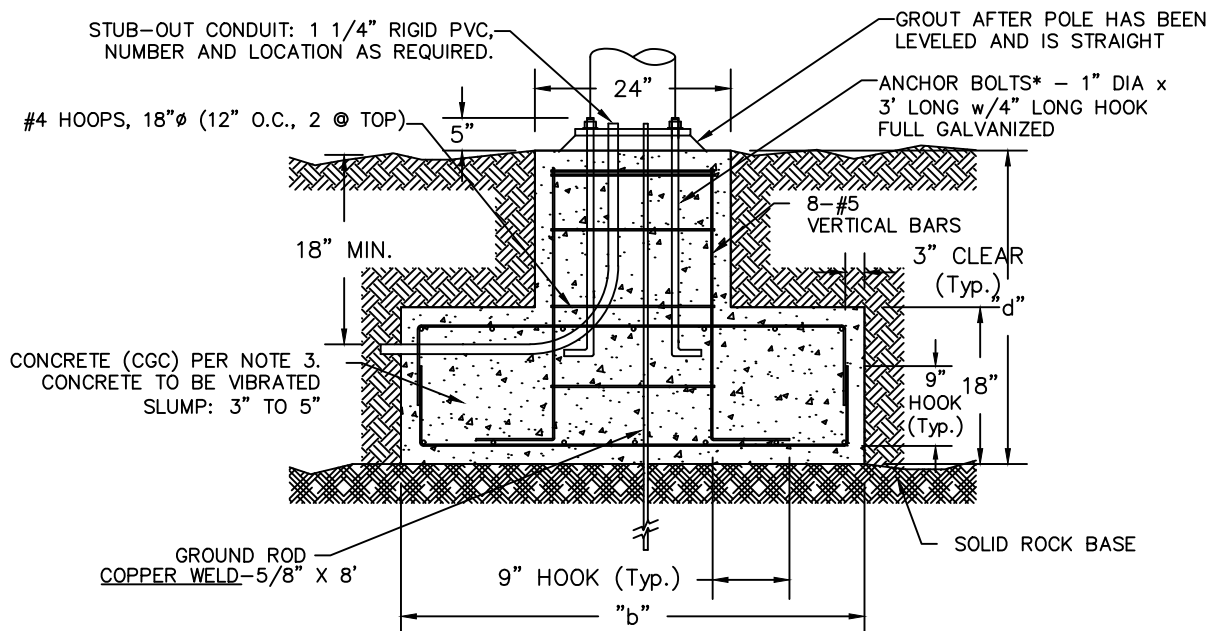


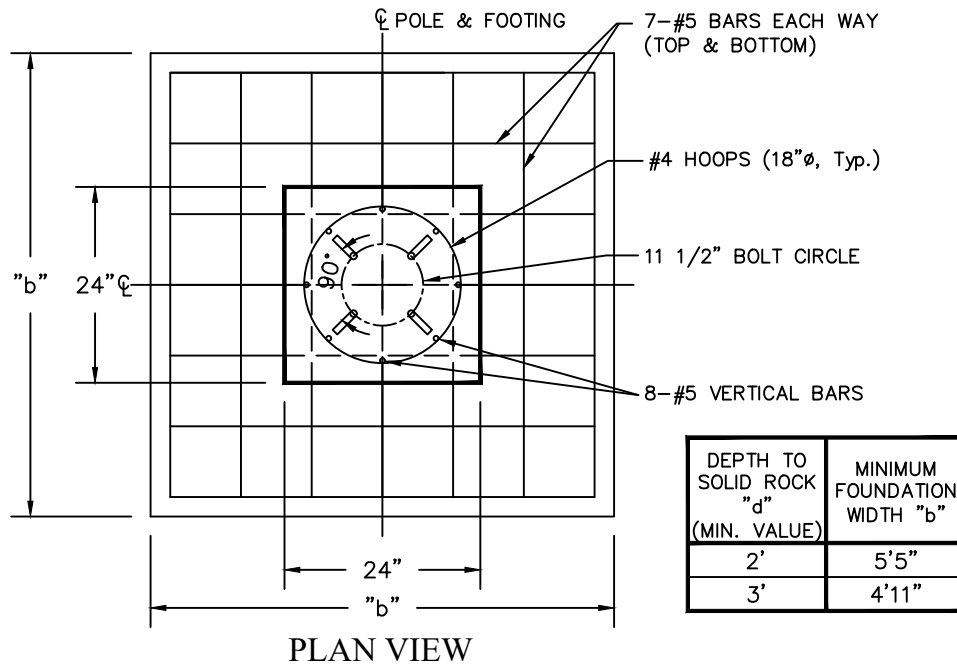

NOTES:

1. REINFORCING STEEL BARS SHOULD BE EQUALLY SPACED WITHIN THE FOOTING, ALLOWING FOR A MINIMUM OF 3" OF CONCRETE COVER OVER THE TIES.
2. STEEL SHALL BE ASTM A615 GR 60 (REBAR).
3. CONCRETE TO BE COMMERCIAL GRADE CONCRETE (CGC) PER 2018 ODOT/OREGON STANDARD SPECIFICATIONS FOR CONSTRUCTION - CLASS 3300.
4. BACKFILL USING STRUCTURAL FILL W/ MINIMUM DRY DENSITY = 100 LBS/FT .

* Anchor Bolts to be F1554GR55

RESIDENTIAL STREET LIGHT FOOTING - SHALLOW DESIGN

ISSUED: LB	9/27/05	PUBLIC WORKS ENGINEERING	DRAWING NO. CD974
DATE: CRZ	7/28/05		
REVISED: MC	DATE: March 2019		
Ashland - Medford - Rogue Valley Sewer Services			