



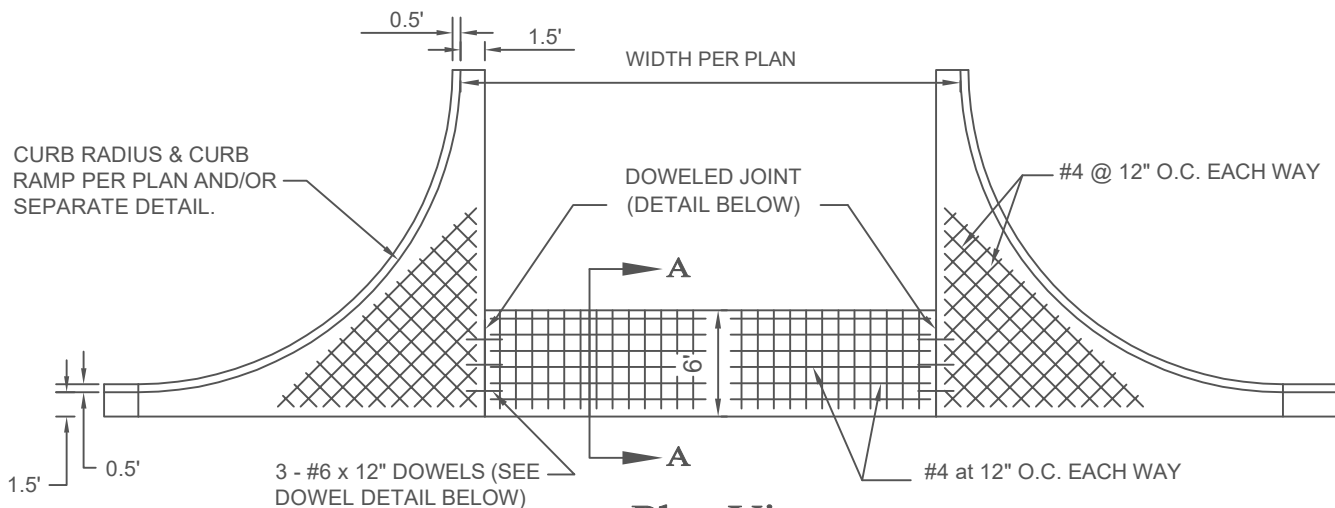

Plan View

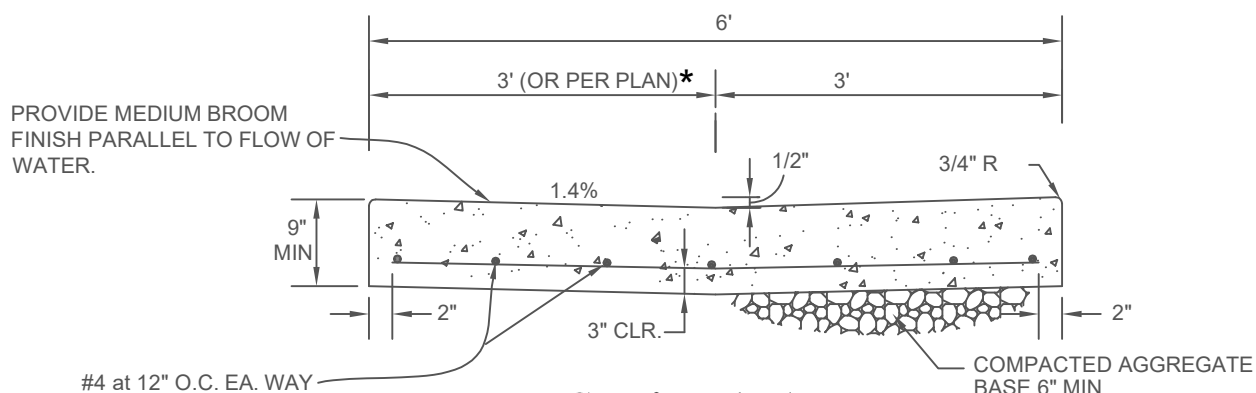


Section A-A

* BASED ON ADA RAMP LOCATION 4' MAY BE REQUIRED FOR PEDESTRIAN ACCESS ROUTE

PLACE 3 - #6 REBAR DOWELS 12" LONG IN CENTER OF SLAB.

BOND BREAKER (15# ROOFING FELT OR EQUAL)

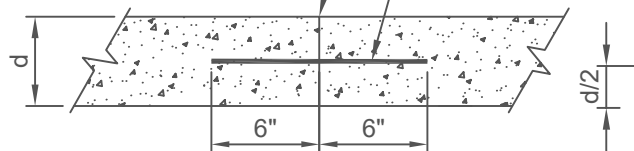

Doweled Joint Detail

GENERAL NOTES:

1. CONCRETE TO BE COMMERCIAL GRADE CONCRETE (CGC) PER LATEST ODOT/OREGON APWA SECTION 00440.00
2. SUBGRADE AND AGGREGATE BASE SHALL BE UNYIELDING AND FIRMLY COMPACTED
3. VALLEY GUTTER SHALL PASS A WATER TEST TO ASSURE FLOW
4. SEE PLAN OR SEPARATE DETAILS FOR CURB, GUTTER, SIDEWALK, RAMPS AND PEDESTRIAN ACCESS ROUTES

The selection and use of this detail, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.



MEDFORD
OREGON

CITY OF MEDFORD
ENGINEERING DEPARTMENT
DETAILS

STANDARD VALLEY GUTTER

DETAIL NO.
DET1702