


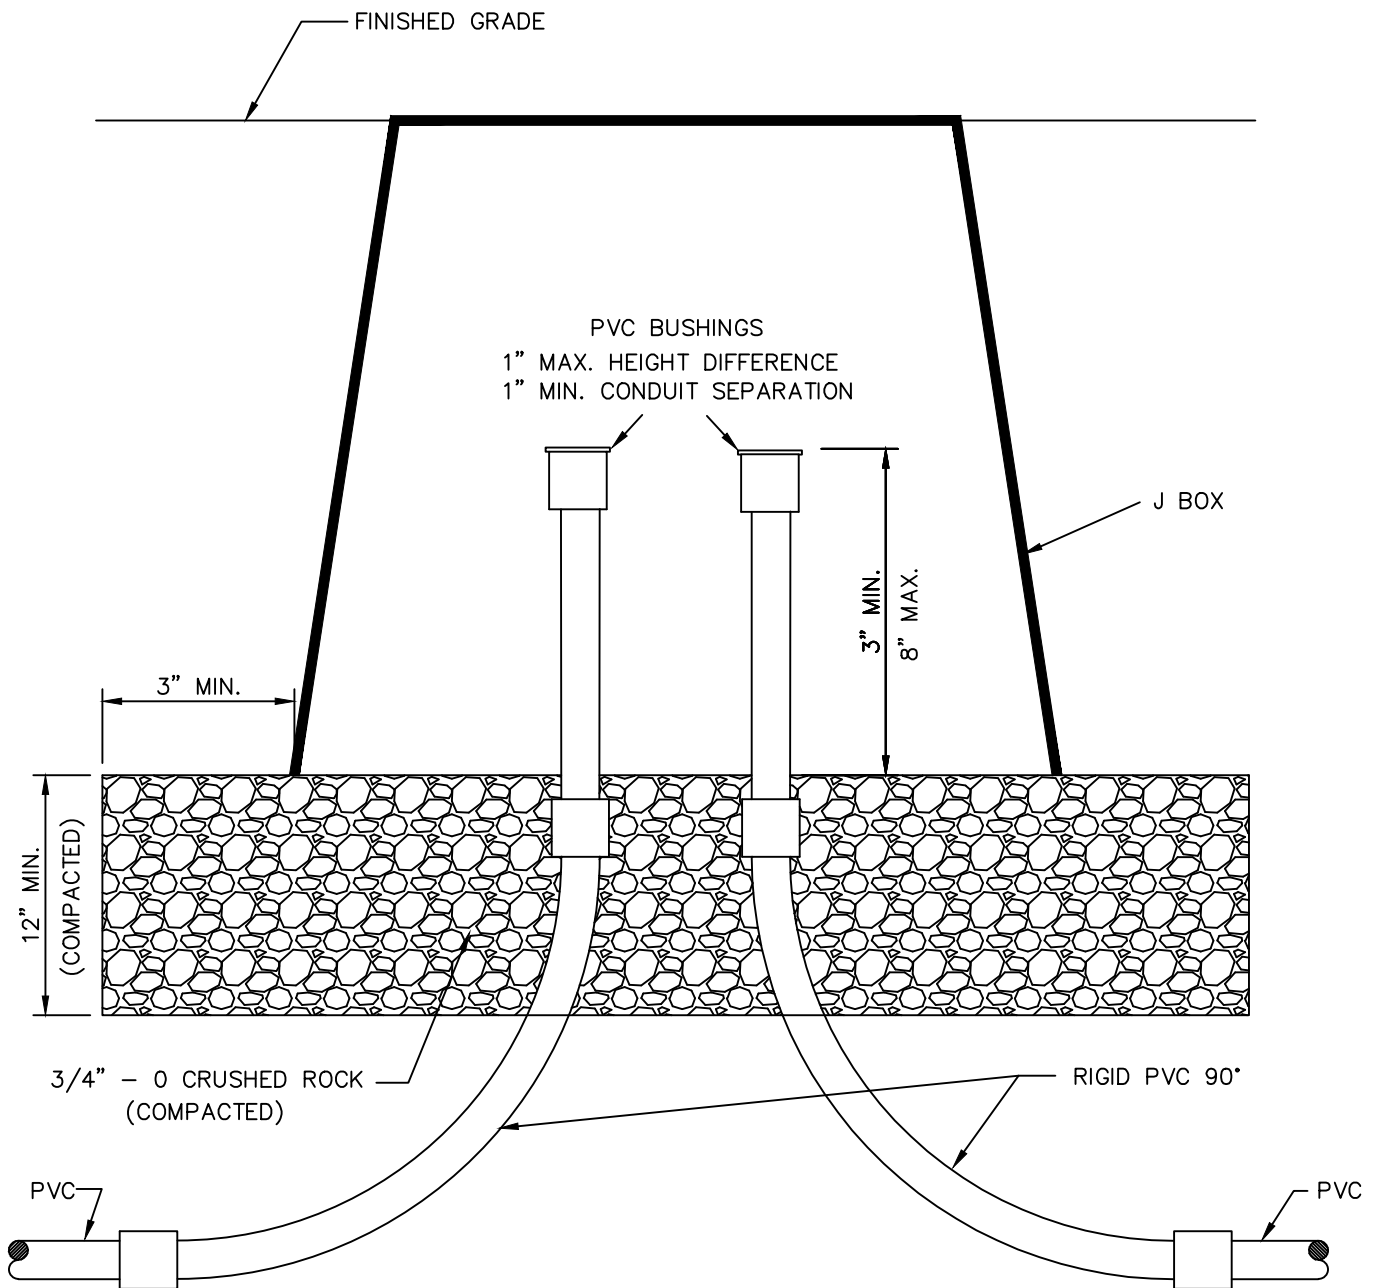

NOTES

- 1) ILLUMINATION CIRCUITS SHALL BE SPLICED ACCORDING TO CITY OF MEDFORD STANDARDS. IN LINE FUSE MAY BE REQUIRED.
- 2) NUMBER OF CONDUITS SHALL BE ACCORDING TO PLANS.
- 3) DUCT SEAL/PLUGS IN ENDS OF CONDUIT.
- 4) ALL CONDUIT ENDS SHALL HAVE A BUSHING. ALL SPARE/FUTURE CONDUITS SHALL HAVE A TRACER WIRE INSTALLED.

JUNCTION BOX DETAIL

ISSUED: LB CRZ	DATE: 9/27/05 7/28/05	PUBLIC WORKS ENGINEERING	DRAWING NO. CD981
REVISED: MC	DATE: Jan. 2022		